



SECTION A-A

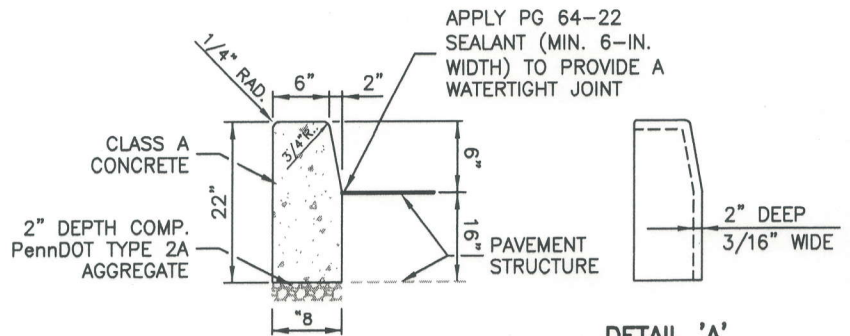


SECTION VIEW

DETAIL 'A'
CONTRACTION JOINT

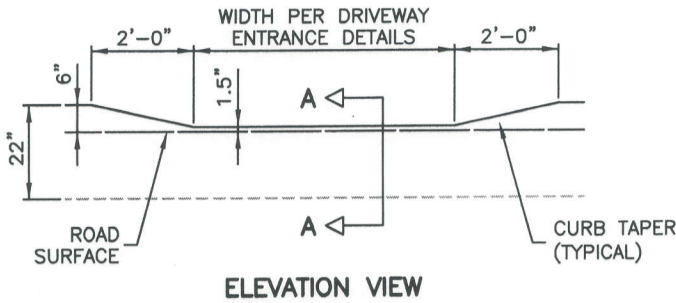

ELEVATION VIEW


DEPRESSED CURB FOR DRIVEWAYS

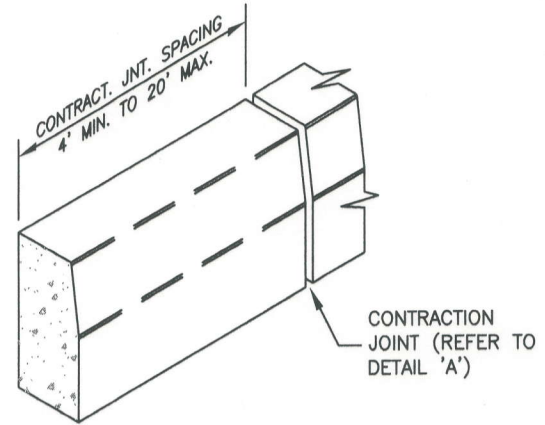

PLAIN CEMENT CONCRETE CURB

NOTES:

1. PROVIDE MATERIALS AND CONSTRUCTION IN ACCORDANCE WITH PennDOT PUBLICATION 408, SECTION 630 FOR PLAIN CEMENT CONCRETE CURB AND SECTION 641 FOR PLAIN CEMENT CONCRETE CURB GUTTER.
2. SPACE CONTRACTION JOINTS IN UNIFORM LENGTHS OR SECTIONS.
3. PLACE 1/2-IN. PREMOULDED EXPANSION JOINT FILLER MATERIAL AT AT MAXIMUM 20-FT. INTERVALS. AT THE END OF EACH WORK DAY, AT POINTS OF TANGENCY TO RADII, AT STRUCTURES, AND BETWEEN THE BACK FACE OF CURB AND SIDEWALK. CUT MATERIAL TO CONFORM TO AREA ADJACENT TO CURB OR TO CONFORM TO CROSS-SECTIONAL AREA OF CURB.
4. CONSTRUCT DEPRESSED CURBS FOR CURB RAMPS IN ACCORDANCE WITH PennDOT PUBLICATION 72, RC-67M.
5. SPECIFICATIONS FOR PAVEMENT RESTORATION SHALL BE DETERMINED BY THE BOROUGH ENGINEER AT THE TIME OF APPLICATION FOR EACH INDIVIDUAL PERMIT.
6. PROVIDE MATERIALS AND CONSTRUCTION FOR ROADWAY RESTORATION IN ACCORDANCE WITH PennDOT PUBLICATION 408 SPECIFICATIONS.
7. WHERE CURB WILL BE INSTALLED ADJACENT TO A PennDOT ROADWAY, CONSTRUCT CURB IN ACCORDANCE WITH PennDOT STANDARDS.
8. WHERE CURB WILL BE INSTALLED ADJACENT TO A PennDOT ROADWAY, APPLICANT IS RESPONSIBLE TO OBTAIN A PennDOT HIGHWAY OCCUPANCY PERMIT FOR THE WORK PRIOR TO ISSUANCE OF A PERMIT BY THE BOROUGH.

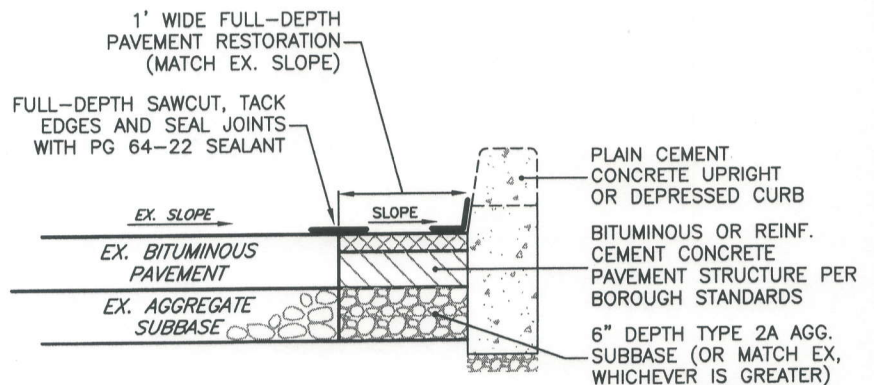

SECTION VIEW

CURB INSTALLATION & PAVEMENT RESTORATION DETAIL



2870 Emrick Boulevard, Bethlehem, PA 18020 P. 610-865-4555
www.KeystoneConsultingEngineers.com F. 610-758-9009

STANDARD CONSTRUCTION DETAILS

PLAIN CEMENT CONCRETE CURBS

BATH BOROUGH, NORTHAMPTON COUNTY, PENNSYLVANIA

DWG. NO. BB-16-001


SCALE: NONE

DWN. BY: KJH


DATE: JUNE 28, 2016

REVISED:

SHEET: 1 OF 1

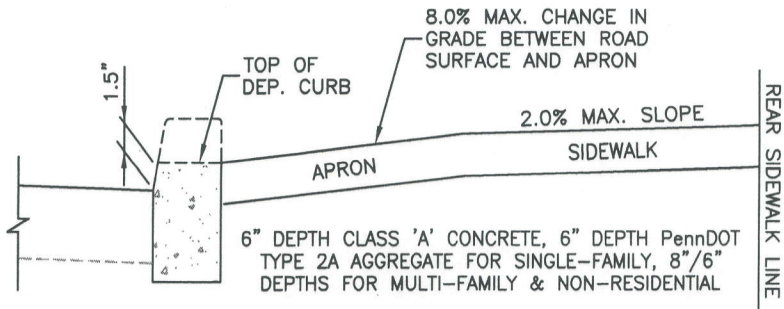


SECTION VIEW

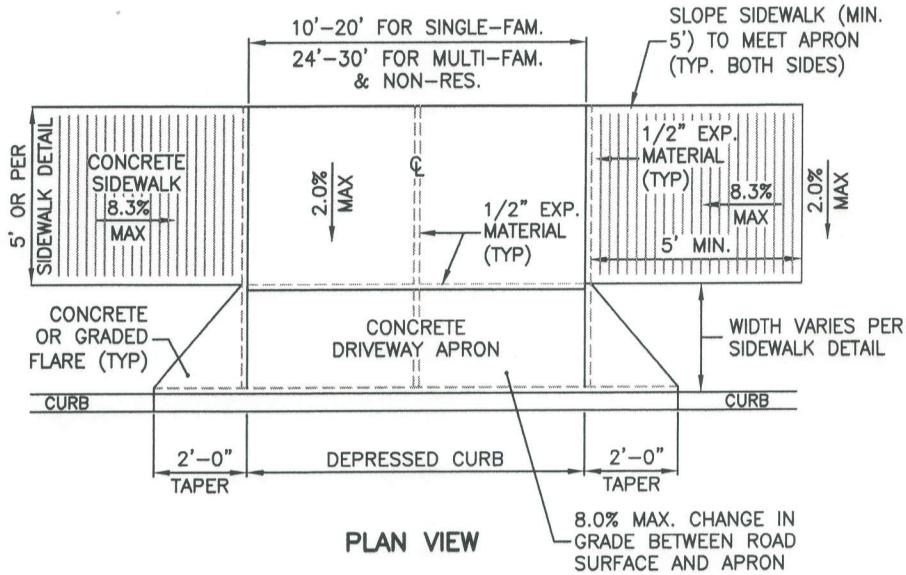

PLAN VIEW

DEPRESSED CURB DRIVEWAY ENTRANCE

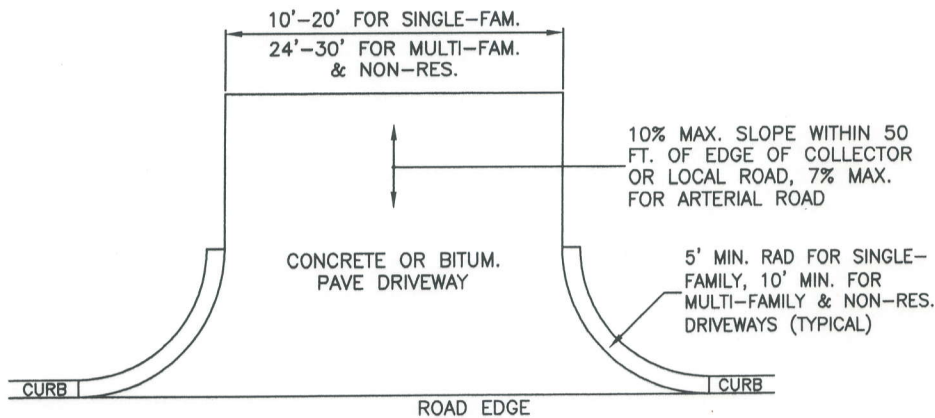


PLAN VIEW

STANDARD DRIVEWAY ENTRANCE

NOTES:

1. PROVIDE MATERIALS AND CONSTRUCTION IN ACCORDANCE WITH PennDOT PUBLICATION 408, SECTION 676 FOR CEMENT CONCRETE SIDEWALKS, EXCEPT MATERIAL DEPTHS AS SPECIFIED HEREIN.
2. PLACE 1/2-IN. PREMOULDED EXPANSION JOINT FILLER MATERIAL AT LOCATIONS INDICATED HEREIN.
3. BOROUGH MAY ALLOW ALTERNATE DRIVEWAY DESIGNS FOUND IN PennDOT PUBLICATION 72, RC-67M UPON REVIEW AND APPROVAL BY THE BOROUGH ENGINEER.
4. CONSTRUCT CURB AND SIDEWALK FOR DRIVEWAY ENTRANCE IN ACCORDANCE WITH BOROUGH STANDARDS.
5. WHERE DRIVEWAY ENTRANCE WILL PROVIDE ACCESS TO A PennDOT ROADWAY, CONSTRUCT DRIVEWAY IN ACCORDANCE WITH PennDOT STANDARDS.
6. WHERE DRIVEWAY ENTRANCE WILL PROVIDE ACCESS TO A PennDOT ROADWAY, APPLICANT IS RESPONSIBLE TO OBTAIN A PennDOT HIGHWAY OCCUPANCY PERMIT FOR THE WORK PRIOR TO ISSUANCE OF A PERMIT BY THE BOROUGH.

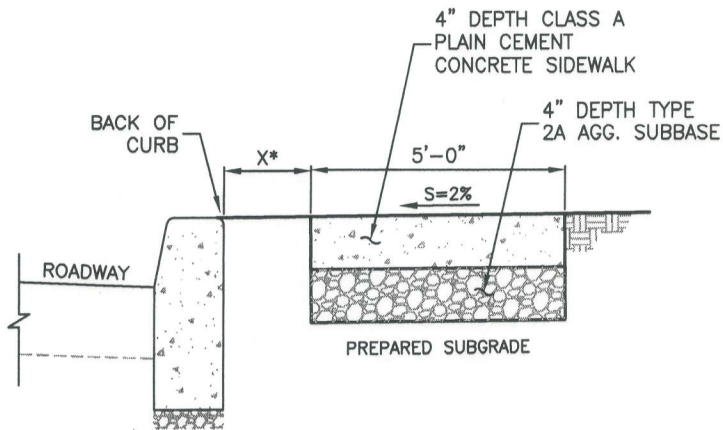

SECTION VIEW


PLAIN CEMENT CONCRETE SIDEWALK

* ADDITIONAL DIMENSIONS:

1. X=3'-0" FOR ARTERIAL ROADS HAVING A 48' WIDE CARTWAY AND AN 80' WIDE RIGHT-OF-WAY
2. X=1'-6" FOR COLLECTOR ROADS HAVING A 36' WIDE CARTWAY AND A 50' WIDE RIGHT-OF-WAY
3. X=2'-0" FOR LOCAL ROADS HAVING A 34' WIDE CARTWAY AND A 50' WIDE RIGHT-OF-WAY
4. X=TO BE DETERMINED BY BOROUGH ENGINEER FOR OTHER ROAD, RIGHT-OF-WAY, AND/OR SIDEWALK WIDTHS

NOTES:

1. PROVIDE MATERIALS AND CONSTRUCTION IN ACCORDANCE WITH PennDOT PUBLICATION 408, SECTION 676 FOR CEMENT CONCRETE SIDEWALKS, EXCEPT MATERIAL DEPTHS AS SPECIFIED HEREIN.
2. PLACE 1/2-IN. PREMOULDED EXPANSION JOINT FILLER MATERIAL AT MAXIMUM 20-FT. INTERVALS. AT THE END OF EACH WORK DAY, AT STRUCTURES, AND BETWEEN THE BACK FACE OF CURB AND SIDEWALK. CUT MATERIAL TO CONFORM TO THE CROSS-SECTIONAL AREA OF THE SIDEWALK.
3. BOROUGH MAY PERMIT REDUCED WIDTH SIDEWALKS (4-FT. MIN.) WHEN 5-FT. x 5-FT. PASSING AREAS ARE PROVIDED AT MAX. 200-FT. INTERVALS.
4. FORM TRANSVERSE DUMMY JOINTS AT 5-FT INTERVALS (OR EQUAL TO REDUCED SIDEWALK WIDTH).
5. APPLY LIGHT BROOM FINISH TO WALK SURFACES.
6. CONSTRUCT DRIVEWAY ENTRANCES IN ACCORDANCE WITH BOROUGH STANDARDS.
7. CONSTRUCT CURB RAMPS IN ACCORDANCE WITH PennDOT PUBLICATION 72, RC-67M.
8. SIDEWALK TREE WELLS REQUIRE APPROVAL BY BOROUGH COUNCIL PRIOR TO INSTALLATION.
9. ALLOWABLE LOCATIONS AND DIMENSIONS OF SIDEWALK TREE WELLS WILL BE DETERMINED BY THE BOROUGH ON AN INDIVIDUAL CASE BASIS.

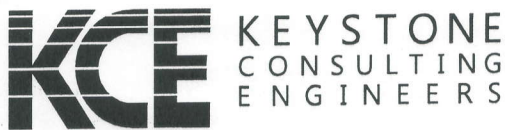

2870 Emrick Boulevard, Bethlehem, PA 18020 P. 610-865-4555
 www.KeystoneConsultingEngineers.com F. 610-758-9009

STANDARD CONSTRUCTION DETAILS

PLAIN CEMENT CONCRETE SIDEWALKS

BATH BOROUGH, NORTHAMPTON COUNTY, PENNSYLVANIA

DWG. NO. BB-16-001
 SCALE: NONE
 DWN. BY: KJH
 DATE: JUNE 28, 2016
 REVISED:
 SHEET: 1 OF 1